


* 78" minimum for installations other than individual, field-installed meter panels. Increase the working-space height for installations greater than 66".

Figure 5-3
Semi-Flush Meter Installation

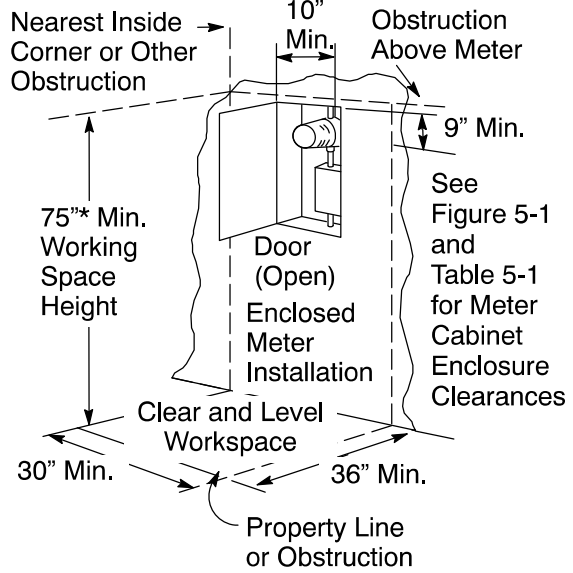

Note: To allow the cabinet door to open fully (90° or more), increase the 30" minimum-width dimension of the meter working space, as necessary.

Figure 5-4
Enclosed Meter Installation